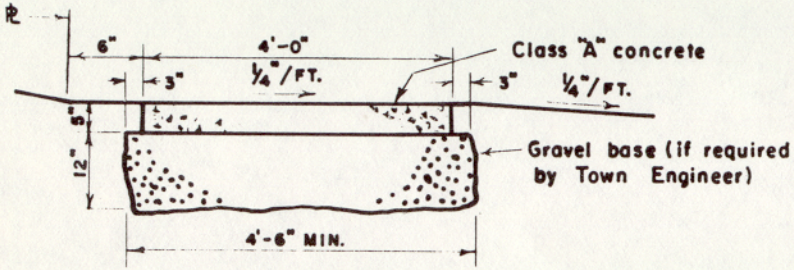

SECTION
5" THICK CONCRETE SIDEWALK



BITUMINOUS CONCRETE
LIP CURBING
(MACHINE FORMED)

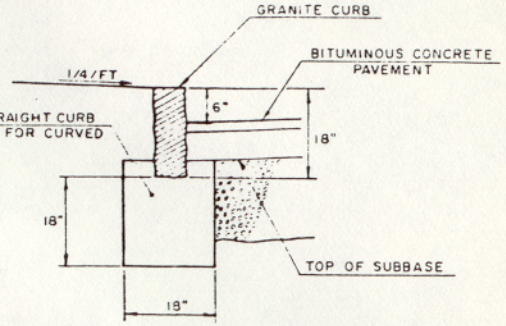

GRANITE STONE CURBING
TOWN STANDARD

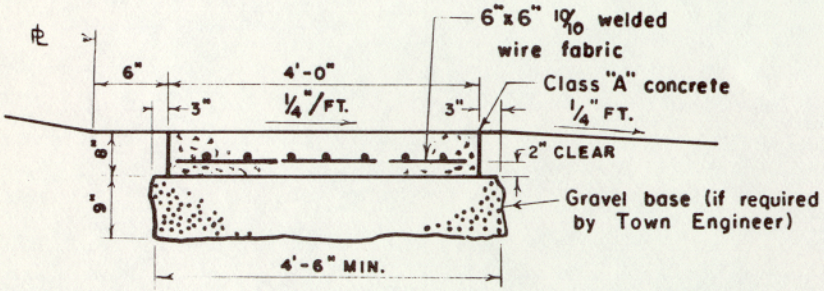

SECTION
8" THICK CONCRETE SIDEWALK

Note:

1. For sidewalk treatment at intersections see street typical cross section sheets.
2. 8" thick side to be used at all driveway crossings and in other areas directed.
3. Tooled joint pattern to be varied as directed to conform to adjacent markings.

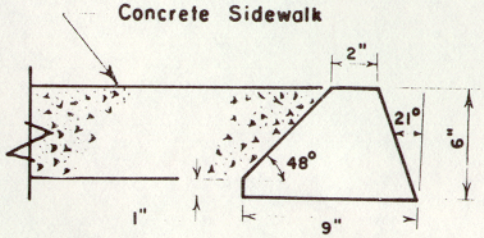

TREATMENT OF BITUMINOUS LIP
CURBING AT SIDEWALK.

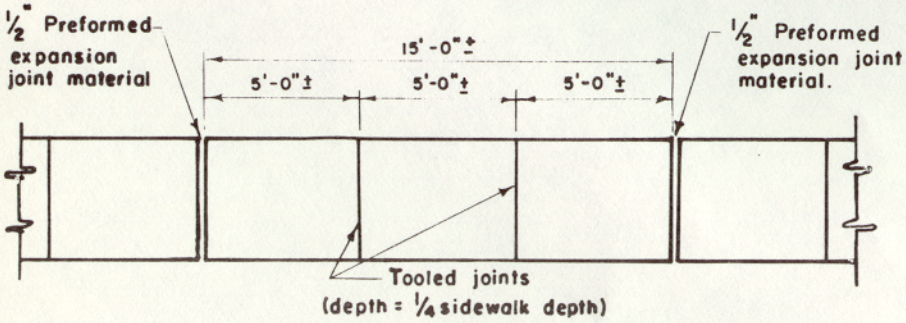

SIDEWALK

NO.	DESCRIPTION	DATE	APPROVED

REVISIONS

TOWN OF EAST HARTFORD, CONN.
STANDARD DETAIL

CURBING AND SIDEWALKS

APPROVED Anthony F. Kayser
CHAIRMAN T.P. & Z. COMMISSION

Arthur J. Mallozzi
DIRECTOR OF PUBLIC WORKS

DATE July 5, 1984